

电力工业电气设备质量检验测试中心

Quality Inspection and Test Center
for Equipment of Electric Power



(2012) 检字 JDL374 号

检 测 报 告

Inspection Report



地 址： 湖北省武汉市洪山区珞喻路 143 号
邮 编： 430074
电 话： 4006565689
传 真： (027) 59832255
网 址： China-qite.sgepri.sgcc.com.cn

电力工业电气设备质量检验测试中心
QUALITY INSPECTION AND TEST CENTER FOR EQUIPMENT OF ELECTRIC POWER
检 测 报 告
INSPECTION REPORT

(2012)检字 JDL374 号
Ref: 2012JDL374

委托单位 上海翔登机电有限公司
Client Shanghai Chardon Electric Ltd.

试样说明

名 称: 12/20 (24) KV 欧式屏蔽型可分离连接器
型号规格: 24-FDT630/24-RDT630/24-DIC630/24-TCP630
制 造 厂: 上海翔登机电有限公司

试品编号: DL2012-374
制造日期: 2012年03月
取样方式: 送样

Description of Samples

Name of Test Samples: 12/20 (24) KV europeanism screened separable connector
Type and Size: 24-FDT630/24-RDT630/24-DIC630/24-TCP630 Year of Manufacture: Mar., 2012
Manufacturer: Shanghai Chardon Electric Ltd.
Sample No.: DL2012-374 Sampling Way: taken by client self

检测标准

GB/T 12706.4—2008 额定电压 1 kV ($U_m=1.2 \text{ kV}$) 到 35 kV ($U_m=40.5 \text{ kV}$) 挤包绝缘电力电缆及附件 第 4 部分: 额定电压 6 kV ($U_m=7.2 \text{ kV}$) 到 35 kV ($U_m=40.5 \text{ kV}$) 电力电缆附件试验要求
IEC 60502-4:2005 额定电压 1 kV ($U_m=1.2 \text{ kV}$) 到 30 kV ($U_m=36 \text{ kV}$) 挤包绝缘电力电缆及其附件 第 4 部分: 额定电压 6 kV ($U_m=7.2 \text{ kV}$) 到 30 kV ($U_m=36 \text{ kV}$) 电缆附件试验要求

Specification

GB/T 12706.4—2008 Power cables with extruded insulation and their accessories for rated voltages from 1 kV ($U_m=1.2 \text{ kV}$) up to 35 kV ($U_m=40.5 \text{ kV}$) — Part 4: Test requirements on accessories for cables with rated voltages from 6 kV ($U_m=7.2 \text{ kV}$) up to 35 kV ($U_m=40.5 \text{ kV}$)
IEC 60502-4:2005 Power cables with extruded insulation and their accessories for rated voltages from 1 kV ($U_m=1.2 \text{ kV}$) up to 30 kV ($U_m=36 \text{ kV}$) — Part 4: Test requirements on accessories for cables with rated voltages from 6 kV ($U_m=7.2 \text{ kV}$) up to 30 kV ($U_m=36 \text{ kV}$)

检测类型 型式试验

Category of Test Type tests

检测日期 2012-07-16~2012-09-20

Date of Testing 2012-07-16~2012-09-20

检测结论 根据 GB/T 12706.4—2008 和 IEC 60502-4:2005 标准, 对上海翔登机电有限公司送检的 24-FDT630/24-RDT630/24-DIC630/24-TCP630 型 12/20 (24) KV 欧式屏蔽型可分离连接器样品进行检测, 型式试验项目合格。

Conclusion The type of 24-FDT630/24-RDT630/24-DIC630/24-TCP630 12/20 (24) KV europeanism screened separable connectors taken to test by client self have passed the type tests specified in GB/T 12706.4—2008 and IEC 60502-4:2005.

检测人员:

Inspected and Tested by

校 核:

Checked by

批 准:

Approved by

赫留洋

He Liuyang

周诚

Zhou Cheng

申

核:

Examined and verified by

闫孟昆

Yan Mengkun

签发日期:

Date of issue:

2012-10-12

1 前言

本报告用中文书写，应委托方要求译成英文。如对本报告的解释有意义上的差异时则以中文为准。

Foreword

This report was written in Chinese and translated into English as requested by the client. In the event of any differences in the interpretation of this report, the Chinese text shall take precedence over the English translation.

2 试样的数量和安装

由制造厂将八个被试样品安装在两根 YJV-12/20 3×185 和两根 YJV-12/20 1×185 的电缆上，包括欧式前插头(24-FDT630)、欧式后插头(24-RDT630)、绝缘保护帽(24-DIC630)、穿墙套管(24-TCP630)构成组合试样，用于进行标准中表 7 规定的 4.1 系列，4.2 系列和 4.3 系列的试验。在组合试样中电缆终端和被试品之间的电缆长度均大于 5 m。标准中表 7 规定的其它试验在单独试样上进行。

The Number and Installation of Combination Samples

It was required that eight samples to be tested were installed with Front T-body(24-FDT630), Rear T-body(24-RDT630), Insulating Cap(24-DIC630), Through Connecting Plug(24-TCP630) by the manufacturer on the cables forming combination samples on which the type tests sequence 4.1 and 4.2 and 4.3 in table 7 were carried out. The cable used in the combination sample was a XLPE insulated three cores cable with rated voltage 8.7/15 kV, a cross-section of 185 sq.mm. The length of the cable in the combination sample was greater than 5 m between terminations and the samples. Other type tests listed in table 7 were carried out on other samples.

3 试验方法

Test Methods

3.1 工频电压试验

试验按 IEC 61442:2005 第 4 章的规定在室温下进行。

AC Voltage Withstand Test

The tests were carried out in accordance with IEC 61442:2005, clause 4.

3.2 局部放电试验

试验按 IEC 61442:2005 第 7 章的规定进行。

Partial Discharge Test

The tests were carried out in accordance with IEC 61442:2005, clause 7.

3.3 冲击电压试验

试验按 IEC 61442:2005 第 6 章的规定进行。

Impulse Voltage Withstand Test

The tests were carried out in accordance with IEC 61442:2005, clause 6.

3.4 恒压负荷循环试验

每个负荷循环时间为 8 h, 其中至少有 2 h 使导体温度保持在正常运行时最高温度以上 5 ℃~10 ℃, 随后至少 3 h 自然冷却至不超过环境温度 10 ℃。在整个试验期间, 试品上应施加 30 kV 的工频电压。

Heating cycle voltage test

Each thermal cycle was of 8 h duration with at least 2 h at a steady temperature of 5℃~10℃ above the maximum cable conductor temperature in normal operation followed by at least 3 h of natural cooling to within 10℃ of ambient temperature. During the whole test period a voltage of 30 kV shall be applied to the sample.

3.5 动热稳定试验

试验按 IEC 61442:2005 第 11 章和第 12 章的规定进行。

Dynamic short-circuit and thermal short-circuit tests

The tests were carried out in accordance with IEC 61442:2005, clause 11 and clause 12.

3.6 屏蔽电阻试验

试验按 IEC 61442:2005 第 15 章的规定进行。

Screen resistance tests

The tests were carried out in accordance with IEC 61442:2005, clause 15.

3.7 屏蔽泄漏电流试验

试验按 IEC 61442:2005 第 16 章的规定进行。

Screen leakage current tests

The tests were carried out in accordance with IEC 61442:2005, clause 16.

4 试验顺序和检测结果

试验顺序和检测结果见表 1 (标准中规定 4.1 系列)、表 2 (标准中规定 4.2 和 4.3 系列)和表 3(其它项目)。

Test Sequence and Results

The test sequence and results were given in Table 1 (sequence 4.1) and Table 2 (sequence 4.2 and 4.3) and Table 3(the other items).

表1 / Table 1

试验顺序 Test sequence	检测项目 Items	标准要求 Requirements	检测结果 Results				评价 Remarks
1	工频电压试验 AC withstand voltage test	54 kV, 5 min, 不击穿 No breakdown shall occur at 54 kV for 5 min	54 kV, 5 min, 组合试样各相均未击穿 No breakdown occurred on the combination samples at 54 kV for 5 min				符合要求 PASS
2	室温下局部放电试验 Partial discharge test at ambient temperature	20 kV 放电量不大于 10 pC The magnitude of the discharge at 20 kV shall not exceed 10 pC	相别 phase	黄 Y	绿 G	红 R	符合要求 PASS
			电压, kV voltage	20	20	20	
			背景, pC noise background	2.0	2.0	2.0	
			放电量, pC discharge	≤ 2.0	≤ 2.0	≤ 2.0	
3	高温下冲击电压试验 Impulse withstand voltage test at 95 °C~100 °C	125 kV, 正负极性各 10 次 (见附录 B) No breakdown shall occur at 10 positive and 10 negative impulses of 125 kV	125 kV, 正负极性各 10 次 (见附录 B) No breakdown occurred on the combination samples at 10 positive and 10 negative impulses of 125 kV (See Annex B)				符合要求 PASS
4	恒压负荷循环试验 Heating cycle voltage test	在 30 kV 电压和导体温度加热至 95°C~100°C 下, 30 次循环在空气中, 30 次循环在水中, 不击穿 30 cycles in air and 30 cycles under water at the conductor temperature of 95°C~100°C and 30 kV, no breakdown shall occur	在 30 kV 电压和导体温度 95 °C~100 °C 下, 共经受了 30 次循环在空气中, 30 次循环在水中, 组合试样均未击穿 No breakdown occurred on the combination samples subjected to 30 cycles in air and 30 cycles under water at the conductor temperature of 95 °C to 100 °C and 30 kV				符合要求 PASS
5	高温下局部放电试验 Partial discharge test at 95°C~100°C	20 kV 放电量不大于 10 pC The magnitude of the discharge at 20 kV shall not exceed 10 pC	相别 phase	黄 Y	绿 G	红 R	符合要求 PASS
			电压, kV voltage	20	20	20	
			背景, pC noise background	2.2	2.2	2.2	
			放电量, pC discharge	≤ 2.2	≤ 2.2	≤ 2.2	

续表1/ Continuing Table 1

试验顺序 Test sequence	检测项目 Items	标准要求 Requirements	检测结果 Results				评价 Remarks
6	室温下局部放电试验 Partial discharge test at ambient temperature	20 kV 放电量不大于 10 pC The magnitude of the discharge at 20 kV shall not exceed 10 pC	相别 phase	黄 Y	绿 G	红 R	符合要求 PASS
			电压, kV voltage	20	20	20	
			背景, pC noise background	1.8	1.8	1.8	
			放电量, pC discharge	≤ 1.8	≤ 1.8	≤ 1.8	
7	冲击电压试验 Impulse withstand voltage test	125 kV, 正负极性各 10 次 (见附录 C) 组合试样各相均未击穿 No breakdown shall occur at 10 positive and 10 negative impulses of 125 kV (See Annex C)	125 kV, 正负极性各 10 次 (见附录 C) 组合试样各相均未击穿 No breakdown occurred on the combination samples at 10 positive and 10 negative impulses of 125 kV (See Annex C)				符合要求 PASS
8	工频电压试验 AC withstand voltage test	30 kV, 15 min, 不击穿 No breakdown shall occur at 30 kV for 15 min	30 kV, 15 min, 组合试样各相均未击穿 No breakdown occurred on the combination samples at 30 kV for 15 min				符合要求 PASS

表2 / Table 2

试验顺序 Test sequence	检测项目 Items	标准要求 Requirements	检测结果 Results	评价 Remarks
1	工频电压试验 AC withstand voltage test	54 kV, 5 min, 不击穿 No breakdown shall occur at 54 kV for 5 min	54 kV, 5 min, 组合试样各相均未击穿 No breakdown occurred on the combination samples at 54 kV for 5 min	符合要求 PASS
2	热稳定试验 (导体) Thermal short-circuit test (conductor)	23.2 kA, 2 s 两次, 无可见的损坏 No visible deterioration at 23.2 kA, 2 s	23.39 kA, 2.02 s 和 23.41 kA, 2.01 s 无可见的损坏 (见附录 E2) No visible deterioration at 23.39 kA, 2.02 s and 23.41 kA, 2.01 s (See Annex E2)	符合要求 PASS
3	动稳定试验 (导体) Dynamic short-circuit test (conductor)	82.0 kA, 不少于 10 ms, 无可见的损坏 No visible deterioration at 82.0 kA at least 10 ms	82.38 kA, 88 ms, 无可见的损坏 (见附录 E1) No visible deterioration at 82.38 kA, 88 ms (See Annex E1)	符合要求 PASS

续表2/ Continuing Table 2

试验顺序 Test sequence	检测项目 Items	标准要求 Requirements	检测结果 Results	评价 Remarks
4	冲击电压试验 Impulse withstand voltage test	125 kV, 正负极性各 10 次 (见附录 D) 组合试样各相均未击穿 No breakdown shall occur at 10 positive and 10 negative impulses of 125 kV (See Annex D)	No breakdown occurred on the combination samples at 10 positive and 10 negative impulses of 125 kV (See Annex D)	符合要求 PASS
5	工频电压试验 AC withstand voltage test	30 kV, 15 min, 不击穿 No breakdown shall occur at 30 kV for 15 min	30 kV, 15 min, 组合试样各相均未击穿 No breakdown occurred on the combination samples at 30 kV for 15 min	符合要求 PASS

表3 / Table 3

试验顺序 Test sequence	检测项目 Items	标准要求 Requirements	检测结果 Results	评价 Remarks		
1	屏蔽电阻试验 Screen resistance tests	老化前后屏蔽电阻 不大于 5000 Ω Screen resistance before and after the heating period shall not exceed 5000 Ω	型号规格 Type and Size	老化前 before ageing	老化后 after ageing	符合要求 PASS
			24-FDT 630	330 Ω	303 Ω	
			24-RDT 630	236 Ω	196 Ω	
2	屏蔽泄漏电流 Screen leakage	在 24.0 kV 下, 泄漏电流不大于 0.5 mA Screen leakage shall not exceed 0.5 mA at 24.0 kV	在 24.0 kV 下, 泄漏电流 小于 0.5 mA Screen leakage didn't exceed 0.5 mA at 24.0 kV		符合要求 PASS	

附录A 检测中使用的主要试验仪器设备清单

Annex A List of the main equipment and instruments used in tests

序号 Seq- uenc -e	仪器设备名称 型号/规格 Name of the equipment and instruments Model / Type	设备编号 No.	测量范围 Measuring range	不确定度/ 准确度 Uncertaint y/ Veracity	检定/校准 机构 Verification /Calibration institution	有效日期 valid period
1	TAWF 串联谐振装置 Series resonance system	312068	(0~75) kV	3 级 Grade 3	国家高电压计量站 National high voltage measurement station	2012-09-25
2	JFD-2H 局放检测系统 PD measurement system	20041202	(0.5~1000) pC	10 级 Grade 10	国家高电压计量站 National high voltage measurement station	2014-05-20
3	冲击分压器 Impulse voltage divider	03	(0~900) kV	2 级 Grade 2	国家高电压计量站 National high voltage measurement station	2014-05-19
4	IPM 23 A 峰值电压表 Meter in peak value of voltage	070	±1600 V	2 级 Grade 2	国家高电压计量站 National high voltage measurement station	2012-10-12
5	H-DJF-2 数据采集系统 Data collected system	CJ06	(0~100) kA	0.5 级 Grade 0.5	国家高电压计量站 National high voltage measurement station	2016-01-03
6	LM-0.5 电流互感器 Current transformer	516	(0~2000) A	0.5 级 Grade 0.5	国家高电压计量站 National high voltage measurement station	2014-09-12
7	MAS-II 数字微安表 MAS-II digital microammeter	20001	(0~1999) uA	2 级 Grade 2	国家高电压计量站 National high voltage measurement station	2012-10-10
8	JSGB-100 数字高压表 Digital high voltage meter	9266	100 kV	1 级 Grade 1	国家高电压计量站 National high voltage measurement station	2013-01-11
9	DT9806 数字多用表 Digital voltage meter	A053632	(0~700) V	1 级 Grade 1	湖北省计量测试技 术研究院 Hubei Institute of Measurement and Testing Technology	2012-10-09

附录B 恒压负荷循环试验前组合试样冲击电压试验实际耐受电压值和冲击电压波形(高温下, 125 kV, 允许 $\pm 3\%$ 偏差)

Annex B The values and oscillograms of impulse voltages on the combination samples before heating cycles voltage test (at high temperature, 125 kV, $\pm 3\%$ tolerance)

B1 冲击电压实际耐受电压值

The values of impulse voltages

温度: 33.5 °C 相对湿度: 64 % 大气压: 0.1002 MPa


Ambient temperature: 33.5 °C, Relative humidity: 64 %, Atmosphere: 0.1002 MPa

单位/unit: kV

正极性 Positive polarity	125.6	125.3	125.8	126.2	126.0	125.7	126.4	125.7	126.1	125.2
负极性 Negative polarity	124.7	125.7	125.4	126.0	126.4	125.9	126.8	125.7	126.2	125.6

B2 冲击电压波形图

Oscillograms of the impulse voltages waveform

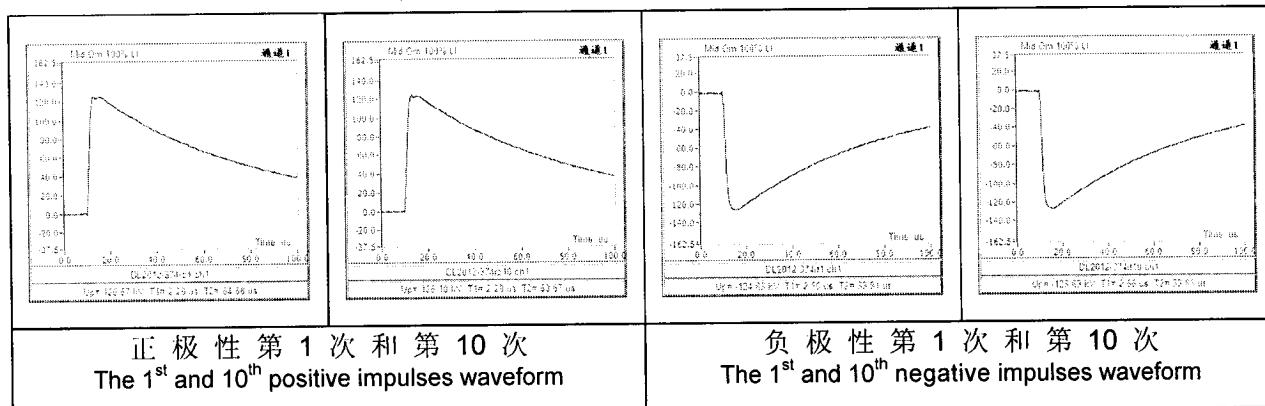

附录C 恒压负荷循环试验后组合试样冲击电压试验实际耐受电压值和冲击电压波形(室温下, 125 kV, 允许 $\pm 3\%$ 偏差)

Annex C The values and oscillograms of impulse voltages on the combination samples after heating cycles voltage test (at ambient temperature, 125 kV, $\pm 3\%$ tolerance)

C1 冲击电压实际耐受电压值

The values of impulse voltages


温度: 29.0 °C 相对湿度: 56 % 大气压: 0.1002 MPa

Ambient temperature: 29.0 °C, Relative humidity: 56 %, Atmosphere: 0.1002 MPa

单位/unit: kV

正极性 Positive polarity	127.1	126.9	126.4	126.0	125.8	126.5	126.1	125.7	126.2	126.5
负极性 Negative polarity	125.7	125.5	125.8	126.1	126.3	125.7	125.5	126.0	125.6	125.9

C2 冲击电压波形图
Oscillograms of the impulse voltages waveform

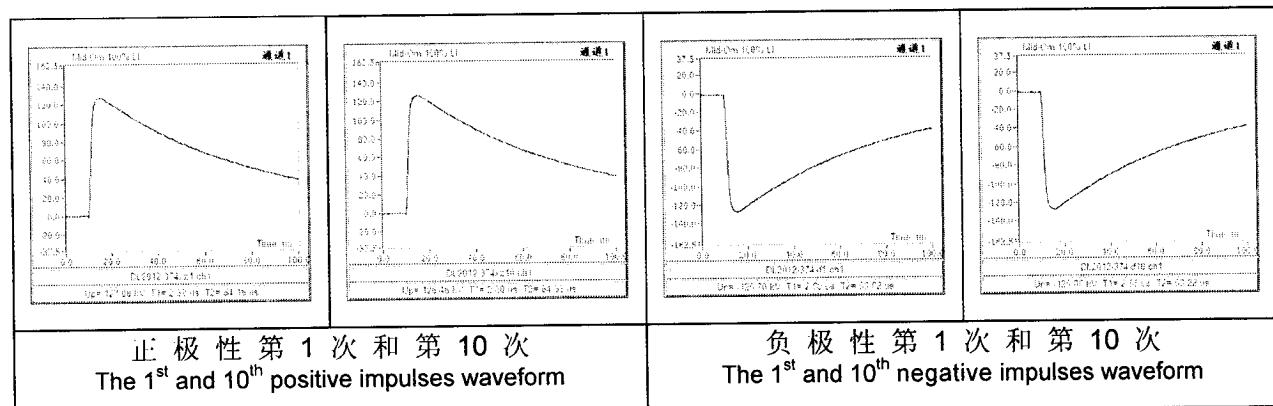

附录D 动热稳定试验后组合试样冲击电压试验实际耐受电压值(室温下, 125 kV, 允许±3%偏差)

Annex D The values of impulse voltages on the combination samples after thermal short-circuit tests (at ambient temperature, 125 kV, ±3 % tolerance)

D1 冲击电压实际耐受电压值

The values of impulse voltages

温度: 26.0 °C 相对湿度: 44 % 大气压: 0.0998 MPa


Ambient temperature: 26.0 °C, Relative humidity: 44 %, Atmosphere: 0.0998 MPa

单位/unit: kV

正极性 Positive polarity	124.3	125.6	126.1	125.9	126.4	125.8	125.9	125.5	125.4	124.6
负极性 Negative polarity	125.2	126.0	126.4	125.3	124.8	125.0	125.5	125.9	125.6	125.1

D2 冲击电压波形图

Oscillograms of the impulse voltages waveform

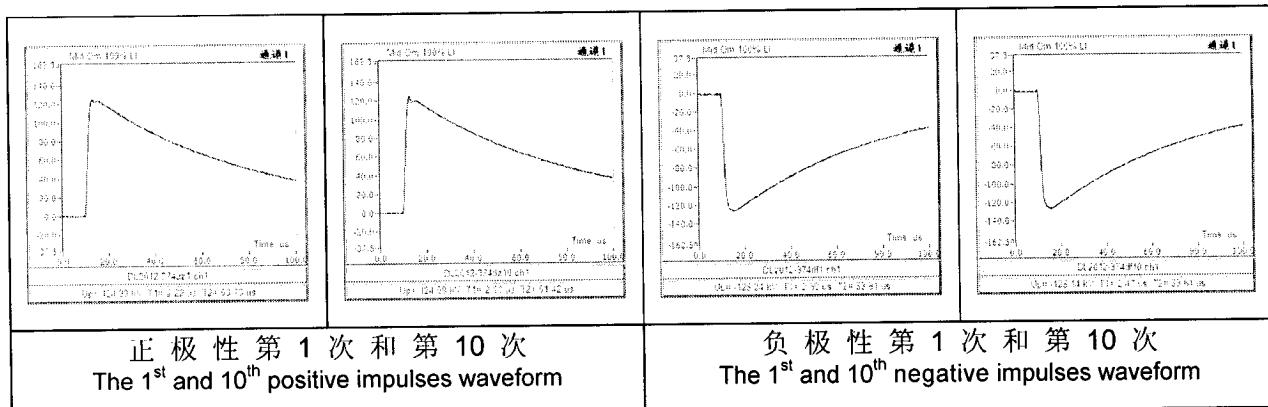


附录E 组合试样动热稳定试验波形

Annex E The waveform of dynamic short-circuit tests and thermal short-circuit tests of the combination sample



E1 组合试样动稳定试验波形（导体）

The waveform of dynamic short-circuit tests of the combination sample (conductor)

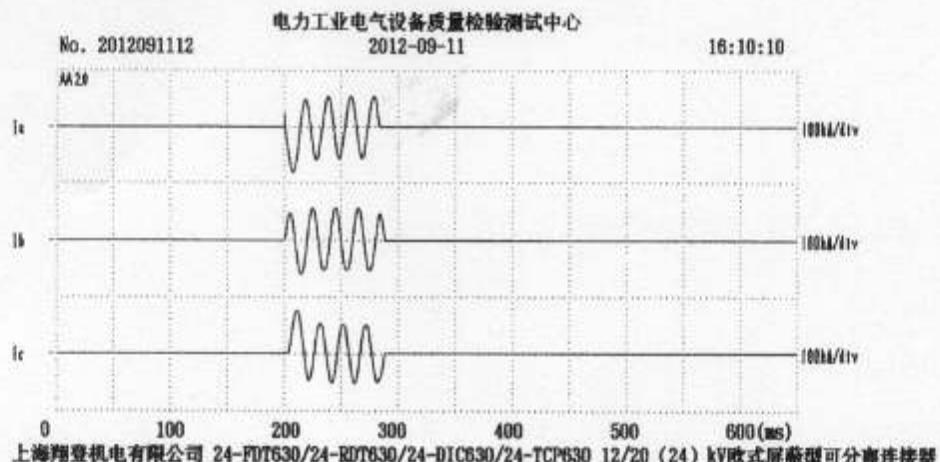


E2 组合试样热稳定试验波形（导体）

The waveform of thermal short-circuit tests of the combination sample (conductor)

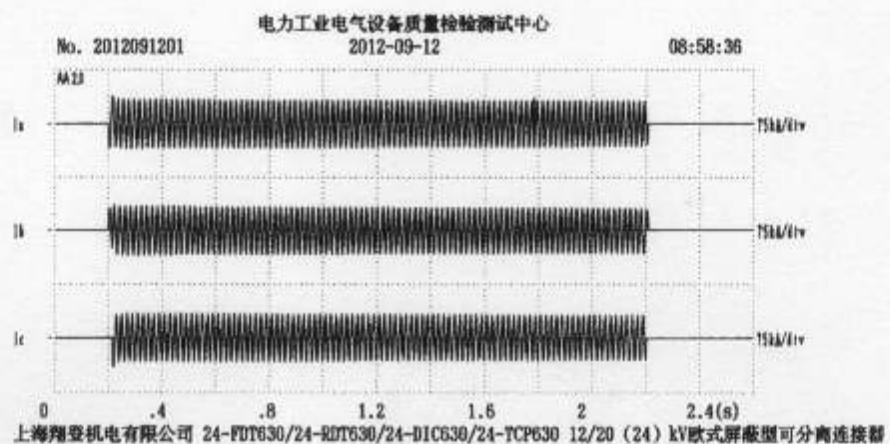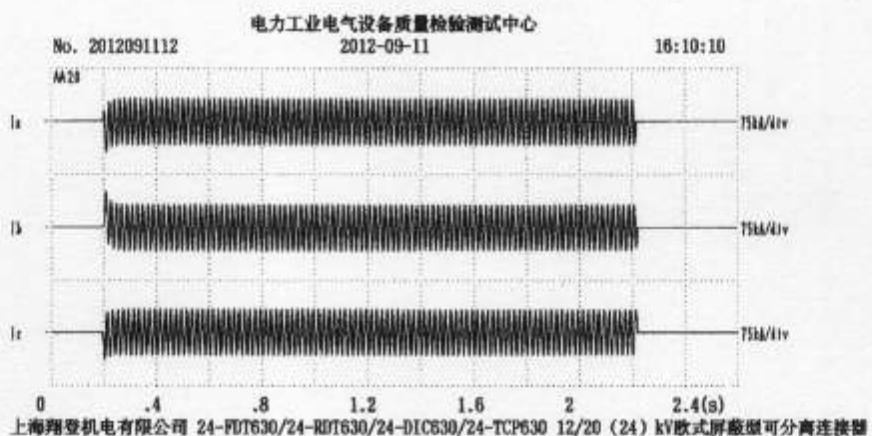

附录F 试验照片
Annex F Photograph about testing

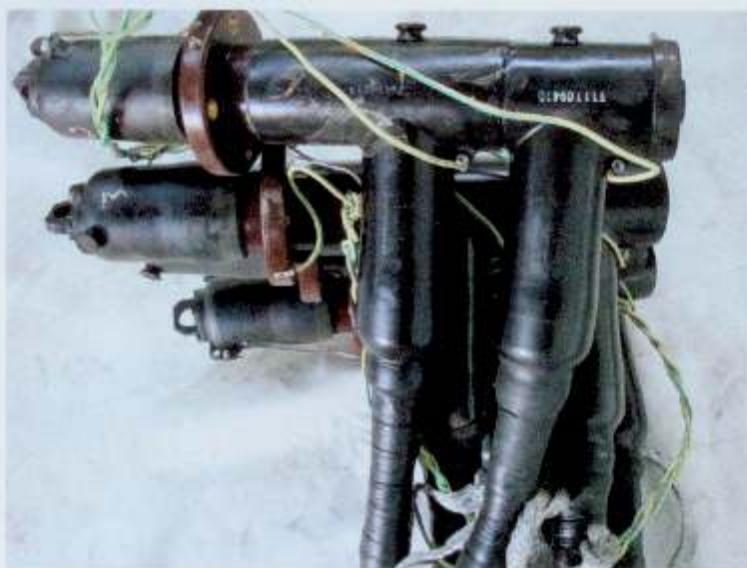

附录G 试验电缆描述
Annex G Identification of test cable

额定电压 rated voltage U_0/U (Um)		12/20 (24) kV
结构 construction	芯数 core	三芯 three cores
	屏蔽结构 construction of screen	分相屏蔽 separated screen
导体 conductor	材质 material	铜 copper
	形状 type	紧压圆形绞合 round compact stranded
	截面 cross section	185 mm ²
	外径 diameter	15.5 mm
绝缘 insulation	材质 material	交联聚乙烯 XLPE
	厚度 thickness	5.6 mm
	外径 diameter	27.4 mm
屏蔽 screen	导体屏蔽厚度 thickness of conductor screen	0.8 mm
	绝缘屏蔽厚度 thickness of insulation screen	0.8 mm
	绝缘屏蔽是否可剥离 strippability of insulation screen	可剥离 strippable
	绝缘屏蔽外径 diameter of insulation screen	28.8 mm
	金属屏蔽 metallic screen	铜带屏蔽 copper tape
铠装 armour		/
外护套 oversheath	材质 material	聚氯乙烯 PVC
	外径 diameter	64.6 mm
电缆标示 mark of cable		YJV-12/20 3×185