



17.5/24kV 250A Deadbreak Elbow Type Test Report

Others

Report Number:

Test Start Date:

Test Complete Date:

RN-R7607-OTHERS

2015 / 01 / 26

2015/ 01 / 29

Chardon Taiwan
No. 37 Min-Chie Road
Tung Lo Industrial Park
Miao Li, Taiwan 366



No. 37, Min-Chie Road, Tung Lo Industrial Park,
Miao Li, 366 Taiwan, R.O.C.
Tel: +886-37-984385 | Fax: +886-37-984770
E-Mail: sales@chardongroup.com

Table of Contents

1.	Screen Resistance Measurement	3
2.	Leakage Current Measurement.....	6
3.	Screen Fault Current Initiation	9
4.	Operating Force	10
5.	Capacitive Test Point Performance	12
6.	Examination.....	14
	APPENDIX – External Test Report Summary	15

1. Screen Resistance Measurement

Object

verify the connectors that the parts meet the resistance requirements of IEC 60502.4/HD629.1S2, $R \leq 5000 \Omega$

Testing Samples

Deadbreak Elbow

CHARDON 24-CE250

4 pcs

Procedures and Test Spec

The test shall be carried out on a separable connector which does not need to be installed on either a cable or a mating bushing. Silver painted or wraparound electrodes shall be installed at each end of the separable connector.

The screen resistance of the separable connector shall be measured at ambient temperature between the two electrodes. The power dissipation of the test circuit shall not exceed 100 mW.

The sample shall then be subjected to thermal ageing in an air oven at $(120 \pm 2) ^\circ\text{C}$ for 168 h under the conditions described in 8.1 of IEC 60811-1-2. The separable connector screen resistance at ambient temperature shall be measured again as above.

Results

Sample number	Screen Resistance
A12	1000.7 Ω
A13	1192.4 Ω
A14	1048.2 Ω
A15	1093.5 Ω



Test in Progress



Readings of the Instrument



Temperature Setup of Oven

2. Leakage Current Measurement

Object

To verify the connectors that the parts meet the Leakage Current Measurement requirements of 60502.4/HD629.1S2, when parts are energized to 24 kV, the leakage current shall not exceed 0.5 mA.

Testing Samples

Deadbreak Elbow	CHARDON 24-CE250	4 pcs
-----------------	------------------	-------

Mating Parts

Deadbreak Bushing	CHARDON 24-DIB250
Cable	20kV YJV 1*50

Procedures and Test Spec

A separable connector shall be installed on a length of cable and connected to its mating bushing. The test shall be carried out at ambient temperature.

A metal foil of 50 mm ×50 mm, shall be fixed without any air gap to the outer screen of the separable connector as far as possible from the earthing points:


- in the case of separable connectors with an earthed metal flange (see Figure 9a), the metal foil shall be placed mid-way between the metal flange and the earth bond of the cable screen;
- in the case of separable connectors without a metal flange (see Figure 9b), the metal foil shall be placed at the end of the separable connector opposite to the earth bond of the cable screen.

In both cases, the metal foil shall be earthed through a millimeter and a resistance of 2 000 Ω, as shown in the test arrangement below.

The leakage current shall be measured with an a.c. test voltage of U_m applied between conductor and earth. ($\leq 0.5\text{mA}$)

Results


Sample number	Leakage Current
A12	7.64 μ A
A13	7.84 μ A
A14	8.23 μ A
A15	7.95 μ A

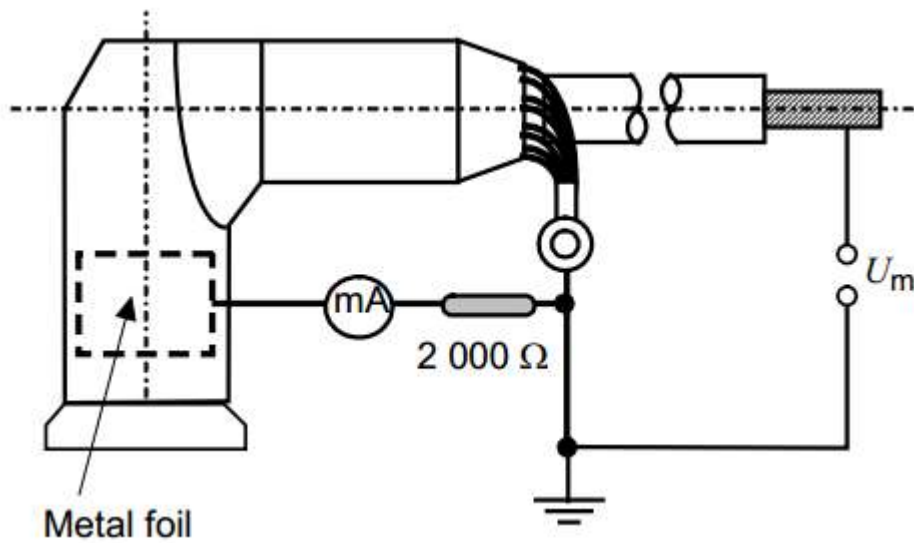

Test Arrangement



Voltage Readings

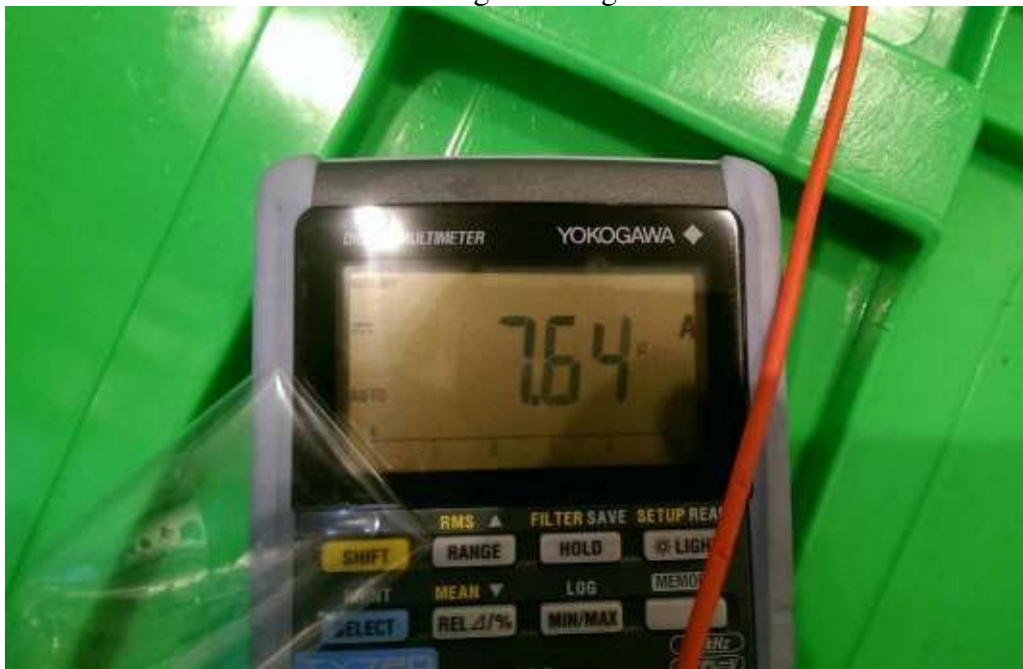

Current Readings



Test in Progress - Close



Test in Progress - Open



Test in Progress I



Test in Progress II

6. Examination

Object

To verify the connectors that parts meet the requirement of IEC 60502.4/HD629.1S2 about examination of the tested samples.

Testing Samples

Deadbreak Elbow

CHARDON 24-CE250

4 pcs

Procedure and Test Spec

The accessories shall be examined and the following information included in the test report:

- (i) Cracking in the filling media and/or tape or tube components;
- (ii) A moisture path bridging a primary seal;
- (iii) Corrosion and/or tracking and/or erosion which would, in time, lead to failure of the accessory.

Results

Sample number	Examination
A12	PASS
A13	PASS
A14	PASS
A15	PASS

APPENDIX – External Test Report Summary



Powertech Labs Inc. • 12388 - 88th Avenue, Surrey, B.C. Canada • V3W 7R7


Test Report № PL-26015B


The tests were performed in accordance with
IEEE Standard 592-2007, section 4.3

Project №:	PL-26015	Test Date:	13 September 2013
Tested equipment:	Two Separable Insulated Connectors manufactured by Chardon Taiwan Corporation, prefaulted in accordance with IEEE Standard 592-2007, Figure 1. The samples were numbered by the client.		
Voltage rating:	15.2 kV _{phase-to-ground}		
Test voltage:	11.7 kV _{phase-to-ground}		
Test current:	10 kA _{rms}		
Markings:	Elbow- Chardon, 15.2/26.3 kV, 200A Load Break Cable- TPC, 25 kV 1/C #1AWG CU, XLPE 260 mils		
Tests performed:	Fault-Current Initiation Tests per Section 4.3. Each sample was subjected to two current pulses at 10 kA _{rms} , 10 cycles.		
Test results:	All tested samples passed the tests.		
Remarks:	Identification of the tested Connectors was based on the markings on the samples. The samples were supplied already prefaulted.		

Tested by:

Reviewed by:


K. Tabarrac M.A.Sc., EIT
Electrical Engineer, High Power Lab

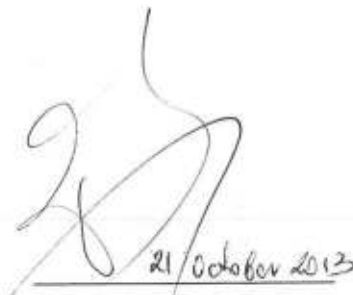
T. Stefanski M.Sc., P. Eng.
Head of High Power Lab

This report shall not be reproduced except in full, without the written approval of Powertech Labs Inc.