

# 600A/900A 15/25 kV Class T-Body Deadbreak Connector



### APPLICATION

Chardon 15/25-TB-600 and 15/25-TB-600T elbows are designed to terminate underground cables to high-voltage apparatus such as transformers and switchgear. They are fully shielded fully submersible and meet the requirements of IEEE Standard 386. They are interchangeable with other manufacturers products that conform with this industry standard.

The capacitive test point on the insulating plug provides a means of testing the circuit without disturbing the bolted connection. In addition to the capacitive test point feature on the insulating plug, Chardon offers an optional capacitive test point on the T-Body connector.

This allows the use of the fault indicators, and provides a hotstick operable means of determining circuit condition when used with high impedance voltage sensing devices designed for test points.

T-Body Connectors are designed for use on solid dielectric cable (XLPE or EPR) with extruded semi-conductive shields and concentric neutral, with or without a jacket. Installation on jacketed concentric neutral cable may require additional sealing material. A special grounding adapter is available for tape shield, linear corrugated, unishield, and drain wire cables for use with Deadbreak connectors.

### KEY FEATURES

- 1 100% factory production testing for partial discharge and AC withstand per IEEE 386.
- Peroxide cured EPDM rubber provides low tension set and high dielectric strength.
- Optional selection of test point installed to provide voltage indication.
- Molded semiconducting shield provides ground shield continuity per the requirements of IEEE 592.
- Grounding Tab and Stress Relief Cone design provide operational safety.
- / Fully meets IEEE 386–2006 specficate

### **PRODUCT RATINGS**


Voltage Class	25 kV	
Max. Rating Phase to Ground	15.2 kV	
AC 1 Minute Withstand	40 kV	
DC 15 Minute Withstand	78 kV	
BILand Full Wave Crest	125 kV	
Partial Discharge	21.5kV ≤5pC	
Continuous	600Arms	
24 Hour Overload	1,000Arms	
Momentary	25,000A symmetrical 10 cycles / 10,000A symmetrical 3.00 sec	
Voltage/Current ratings and characteristics are in accordance with IEEE Std 386 standard.		


· 15/25TB600-121825-REV05

### T-BODY KIT CONTENT

#### Tests conducted in accordance with IEEE Standard 386.

- / T-Body
- Insulating Plug (Al for 600A, Cu for 900A)
- / Cable Adapter
- Stud
- / Compression Lug (Al for 600A, Cu for 900A)
- Silicone Grease
- Installation Instructions Sheet





# **PRODUCTION TESTS**

#### Tests conducted in accordance with IEEE Standard 386.

Partial Discharge - 21.5kV ≤5pC

/ AC 1 Minute Withstand - 40kV

#### Tests conducted in accordance with Chardon Manufacturing Process requirements:

- Physical Inspection
- Periodic Dissection
- Periodic X-ray Analysis


# DETAILED COMPOSITION OF THE CHARDON 15/25KV 600A T-BODY DEADBREAK CONNECTOR

#### **/** T-BODY CONNECTOR BODY

characteristics.

shield continuity and meets the requirements of IEEE Standard 592.

Molded T-body adapts to all cable sizes and provides a dead front shielded connection.

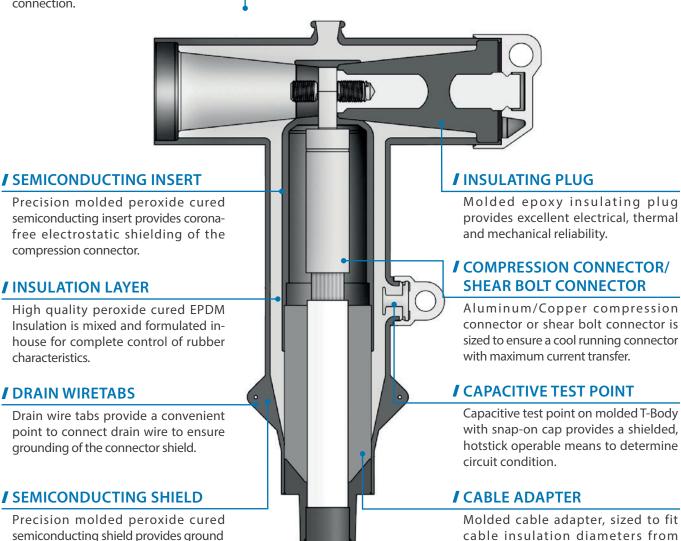

0.640 inch to 1.965 inches (16.3 to

49.9 mm), provides stress relief for

the terminated cable.

# **ORDERING INFORMATION**



STEP1 \_\_\_\_

### **Selection of Current Rating and test Point**

Code	
600	600AMP WITHOUT Test Point
600T	600AMP WITH Test Point
900	900AMP WITHOUT Test Point
900T	900AMP WITH Test Point

Note

(1) 600A compression lugs are made from aluminum.

(2) 600A insulating plugs include an aluminum conductor.

(3) 900A compression lugs are made from copper.

(4) 900A insulating plugs include a copper conductor.

STEP2 \_

#### **Selection of Cable Insulation Dimension**

Range Code	Inches	mm
A	0.640 - 0.760	16.3 - 19.3
В	0.720 - 0.845	18.3 - 21.5
C	0.785 - 0.970	19.9 - 24.6
D	0.910 - 1.065	23.1 - 27.1
E	0.980 - 1.140	24.9 - 29.0
F	1.080 - 1.280	27.4 - 32.5
G	1.220 - 1.420	31.0 - 36.1
Н	1.360 - 1.560	34.5 - 39.6
J	1.480 - 1.700	37.6 - 43.2
K	1.640 - 1.840	41.7 - 46.7
L	1.780 - 1.965	45.2 - 49.9

#### ORDERING INFORMATION



STEP3 \_\_\_\_

Selection of Conductor Size (Al, Cu or Bi-Metal), add BMC in end of part number if a bi-metal lug is required. For example. 0002BMC; add CC in end of part number if a Copper lug is required. For example. 0002CC; add Al in end of

part number if a Aluminum lug is required. For example. 0002Al. When selecting a shear bolt connector, use"shear bolt connector conductor code chart"and add SBC in the end of part number. For example, SBC-B-25-50/1.

#### **Conductor Code Table**



CONDUCTOR	Concentric or Compressed		Compactor Solid		Inner Diameter ØA(mm)
CODE	AWG or kcmil	mm²	AWG or kcmil	mm²	Copper/Bi-metal/Aluminum Lug
0002	#2	35	#1	-	7.90
0001	#1	-	1/0	50	8.70
0010	1/0	50	2/0	70	10.02
0020	2/0	70	3/0	-	11.10
0030	3/0	-	4/0	95	12.40
0040	4/0	95	250	120	13.90
0250	250	120	300	150	15.00
0300	300	150	350	-	16.40
0350	350	-	400	185	17.90
0400	400	185	450/500	-	19.30
0450	450	-	500/550	240	20.10
0500	500	240	600	300	21.50
0550	550	-	650	-	22.60
0600	600	300	700	-	23.30
0650	650	-	750	400	24.10
0750	750	400	800	-	26.20
0800	800	-	900	-	27.10
0900	900	-	1000	500	28.70
1000	1000	500	-	-	30.20

Note

Aluminum lug and Bi-metal lug for use on copper and aluminum conductors. Cooper lug for use on cooper conductors only.

#### **Chardon Shear Bolt Connector**

Example

For a Shear Bolt Connector with a conductor range between 20-50 mm<sup>2</sup>, the part number would be : SBC-B-25-50/1-AL.

CATALOG NO.	Conductor Range(mm²)
SBC-B-25-50/1-AL	25-50
SBC-B-70-120/2-AL	70-120
SBC-B-150-240/2-AL	150-240
SBC-B-120-300/2-AL	120-300
SBC-B-300-400/3-AL	300-400



# **ORDERING EXAMPLE**

An 15/25 kV Elbow, with a test point, and with copper lug required cable insulation dimension of 1.45 inch, and the compressed cable conductor size type is 550, the part number would be as follows:

15/25-TB	900T	0550CC			
If a shear bolt connector is selected in this kit, the part number would be as follows:					
15/25-TR	900T	ш	SRC-R-25-50/1-AI		

The part number includes the insulating plug, cap, and stud.

#### Note:

If you require a T-body installed with LRTP, a threaded lug is necessary for the installation. Please notify your local agent or Chardon of the need for this threaded lug.

